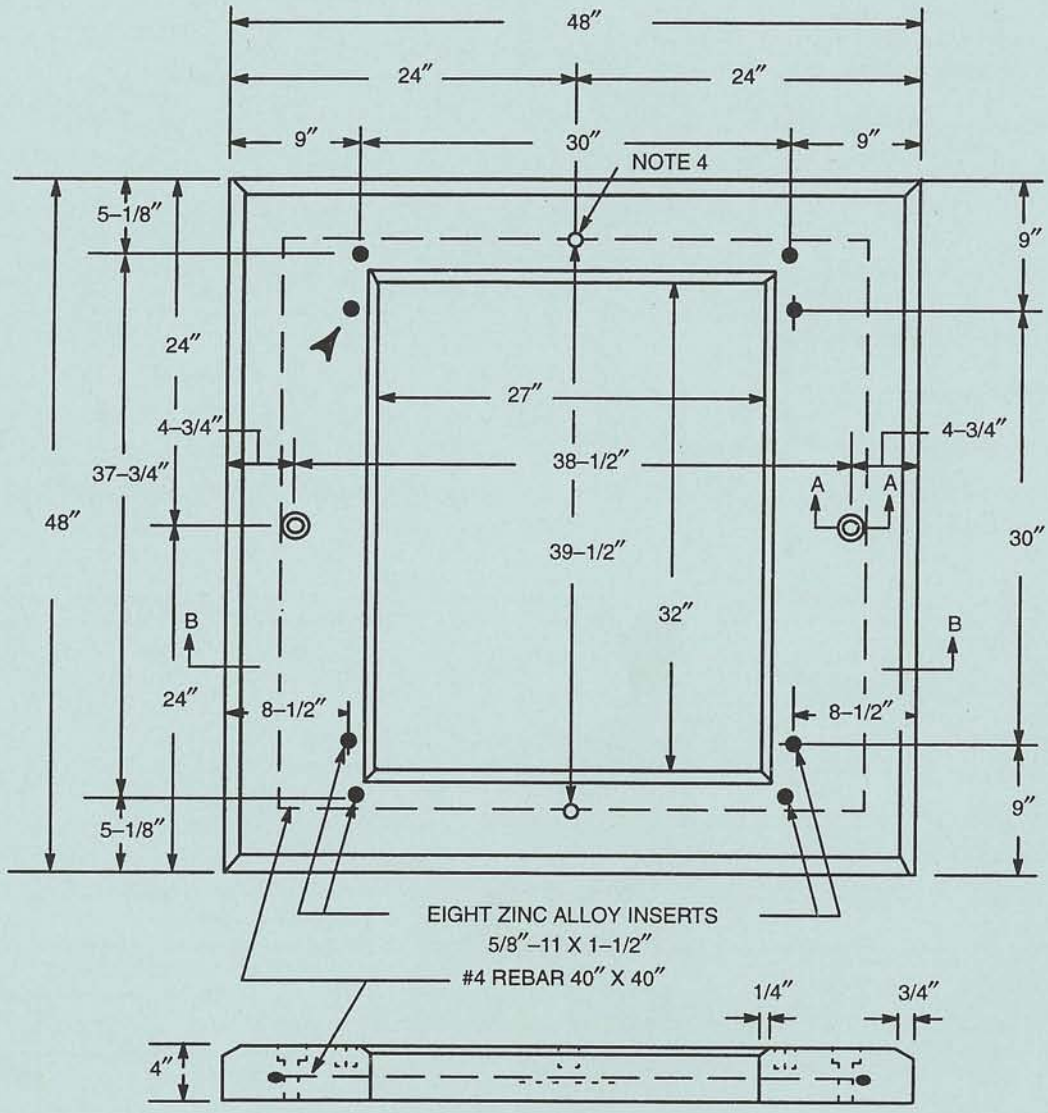

SECTION B–B

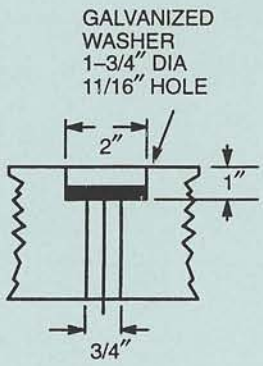

SECTION A–A

NOTES

1. Final 28 day concrete strength to be 5000 psi.
2. Manufacturer's identification and month/year when manufactured shall be legibly marked in/on concrete in the top within 4 inches of the opening.
3. Concrete and concrete design shall be in accordance with ACI 318–1986.
4. Two 3/4 inch coil loop inserts (Dayton F63) with an insert locator plug (Dayton T21) for lifting the pad with a swivel plate.

ORIGINAL 2/17/76 APPROVED 11/1/94 FCH	PAD – ENCLOSURE – PRECAST CONCRETE 48″ X 48″ X 4″			
	NORTHEAST UTILITIES	MATERIAL SPECIFICATION	SPC P–017	9